




**CER-TEMP 80 WIRING DIAGRAM FOR  
MULTIPLE DURA-MAX MODELS  
DW-720 THRU DW-1810  
WITH IID SYSTEM  
120 VOLT SYSTEM**

**UNIT #1  
SEE RESPECTIVE UNIT DIAGRAM  
FOR FACTORY INSTALLED WIRING.**

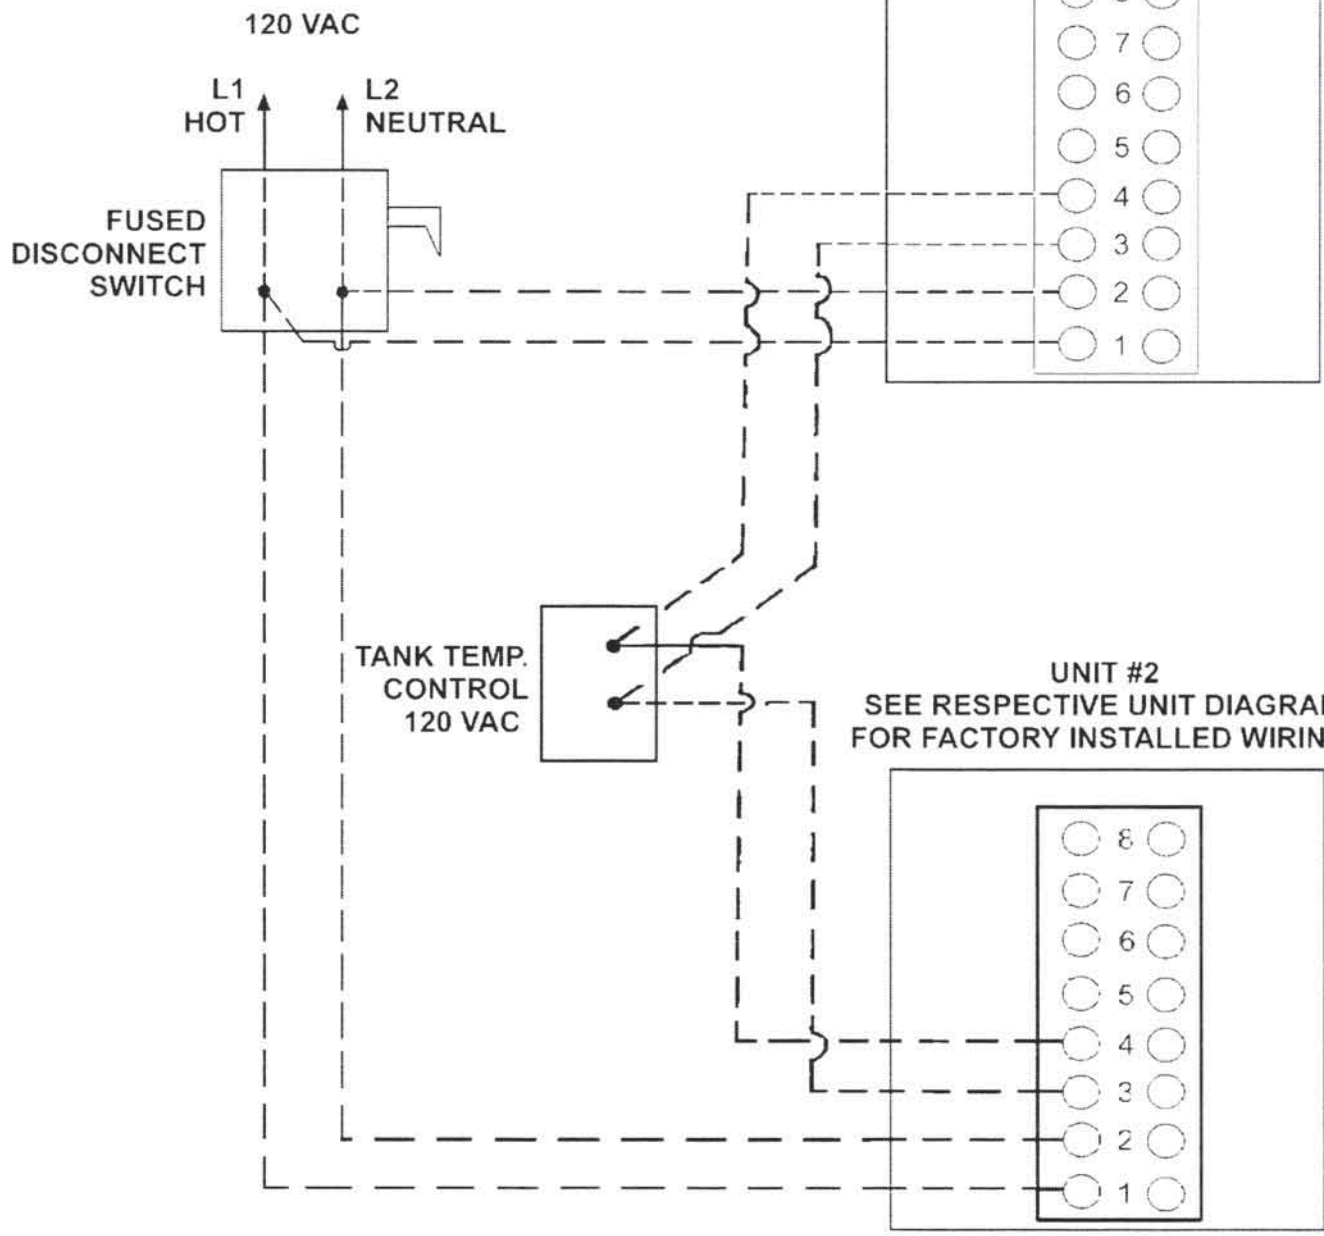

----- FIELD WIRING


IF ANY OF THE ORIGINAL WIRES AS SUPPLIED MUST BE REPLACED,  
USE ONLY TYPE 105°C THERMOPLASTIC OR ITS EQUIVALENT.




**CER-TEMP 80 WIRING DIAGRAM FOR  
MULTIPLE DURA-MAX MODELS  
DW-720 THRU DW-1810  
WITH IID SYSTEM  
24 VOLTS (SMR Z-29)**



**UNIT #1  
SEE RESPECTIVE UNIT DIAGRAM  
FOR FACTORY INSTALLED WIRING.**

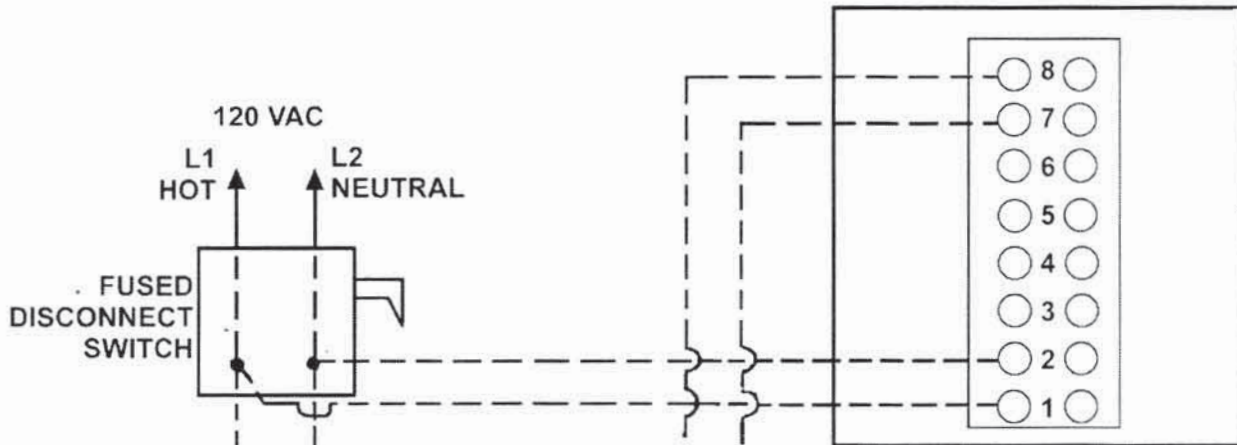

**UNIT #2  
SEE RESPECTIVE UNIT DIAGRAM  
FOR FACTORY INSTALLED WIRING.**

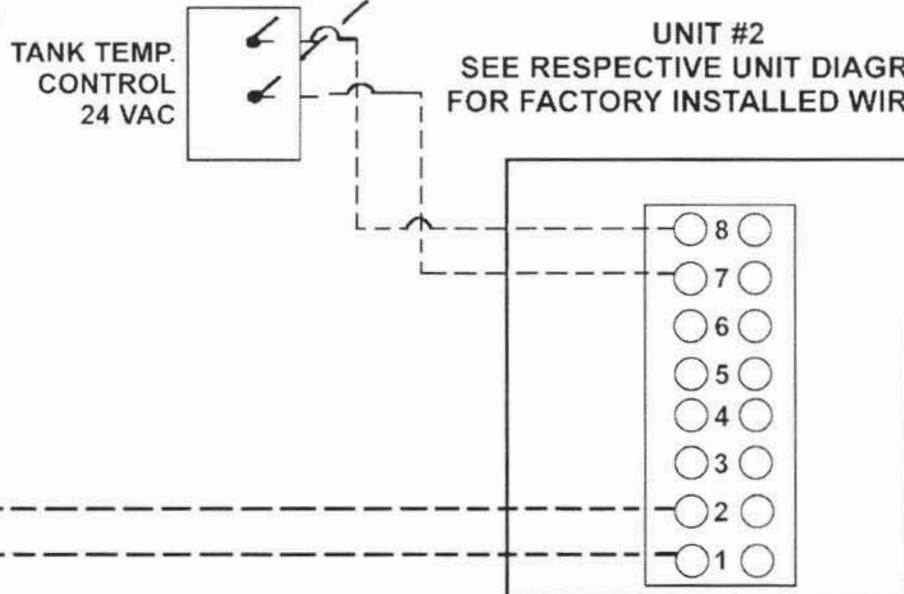

----- FIELD WIRING

IF ANY OF THE ORIGINAL WIRES AS SUPPLIED MUST BE REPLACED,  
USE ONLY TYPE 105°C THERMOPLASTIC OR ITS EQUIVALENT.