




**CER-TEMP 80 WIRING DIAGRAM FOR
MULTIPLE DURA-MAX MODELS
DW-720 THRU DW-1810
WITH IID SYSTEM
120 VOLT SYSTEM**

**UNIT #1
SEE RESPECTIVE UNIT DIAGRAM
FOR FACTORY INSTALLED WIRING.**

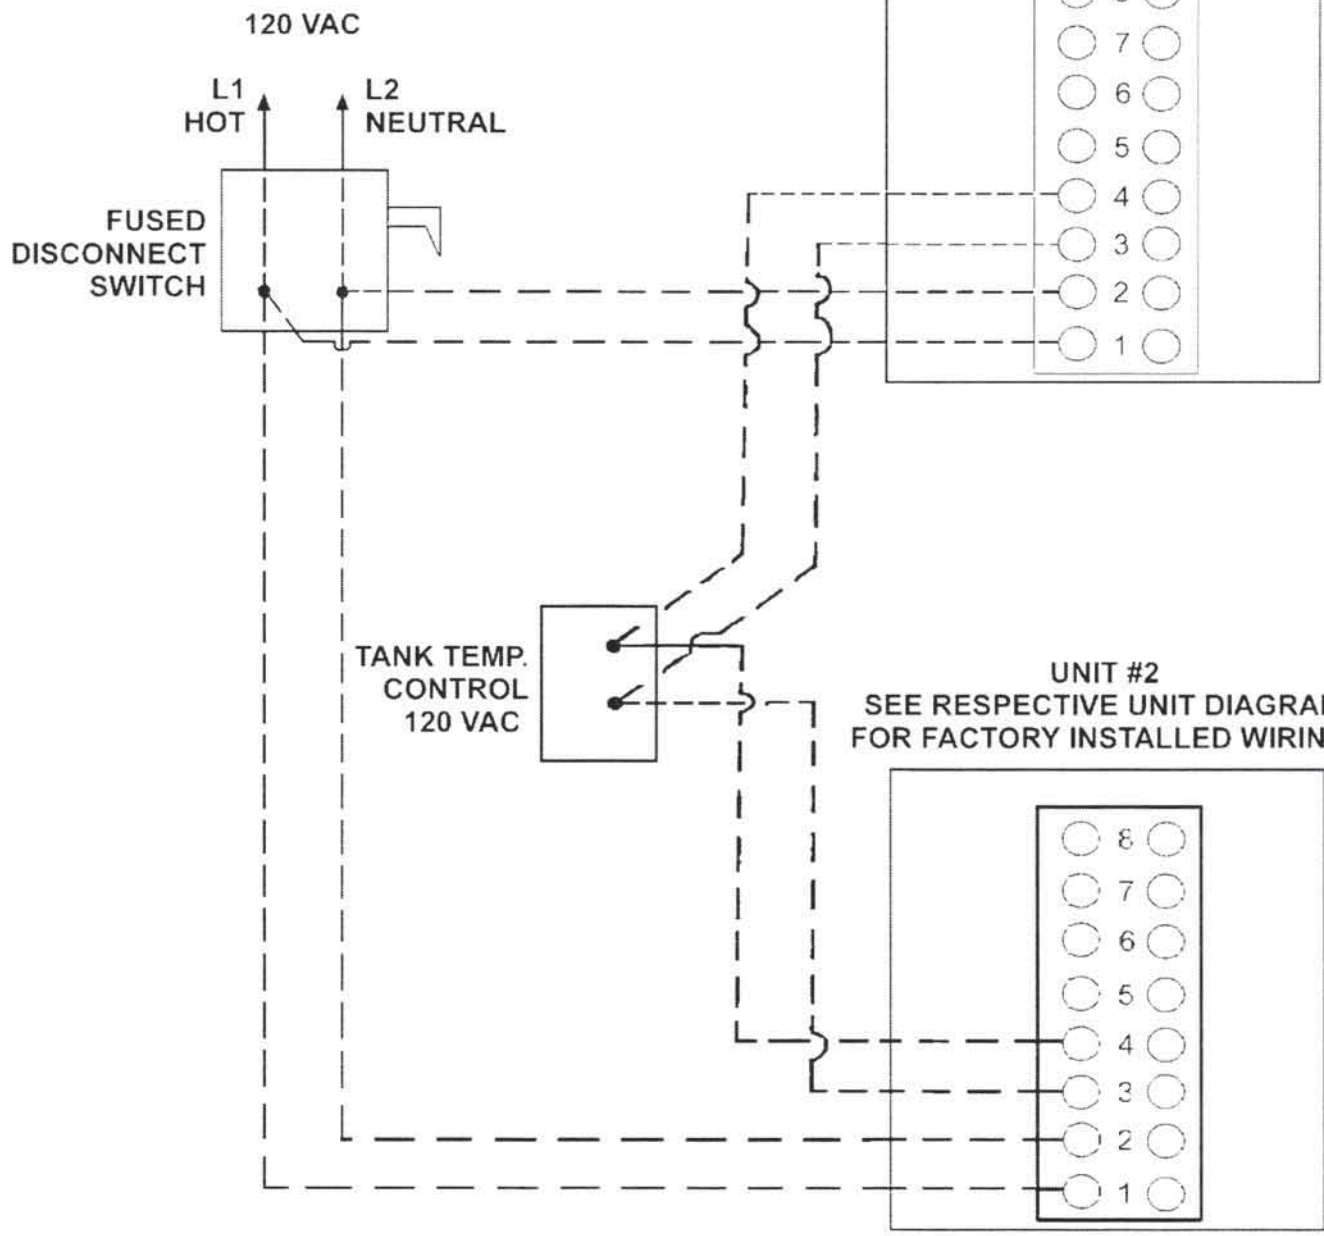

----- FIELD WIRING


IF ANY OF THE ORIGINAL WIRES AS SUPPLIED MUST BE REPLACED,
USE ONLY TYPE 105°C THERMOPLASTIC OR ITS EQUIVALENT.




**CER-TEMP 80 WIRING DIAGRAM FOR
MULTIPLE DURA-MAX MODELS
DW-720 THRU DW-1810
WITH IID SYSTEM
24 VOLTS (SMR Z-29)**



**UNIT #1
SEE RESPECTIVE UNIT DIAGRAM
FOR FACTORY INSTALLED WIRING.**

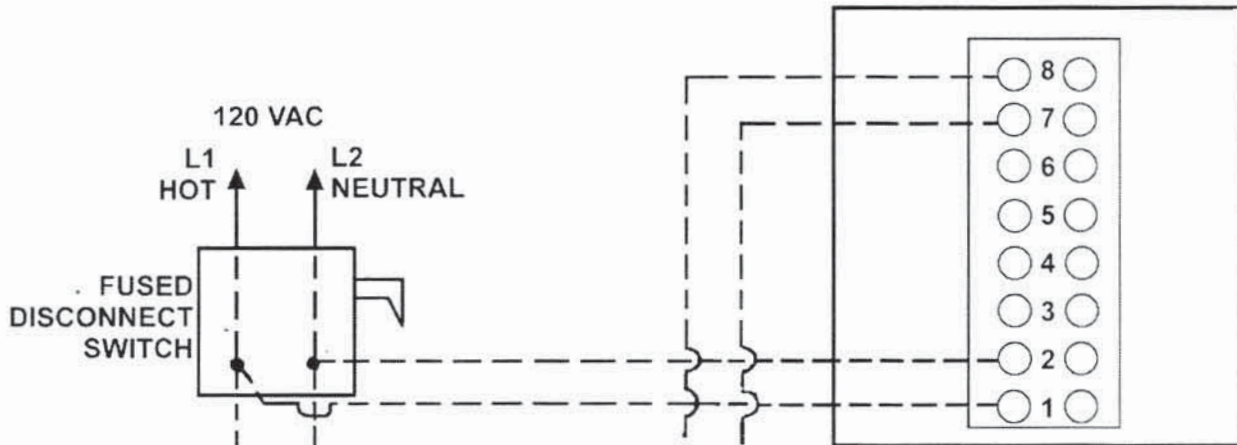

**UNIT #2
SEE RESPECTIVE UNIT DIAGRAM
FOR FACTORY INSTALLED WIRING.**

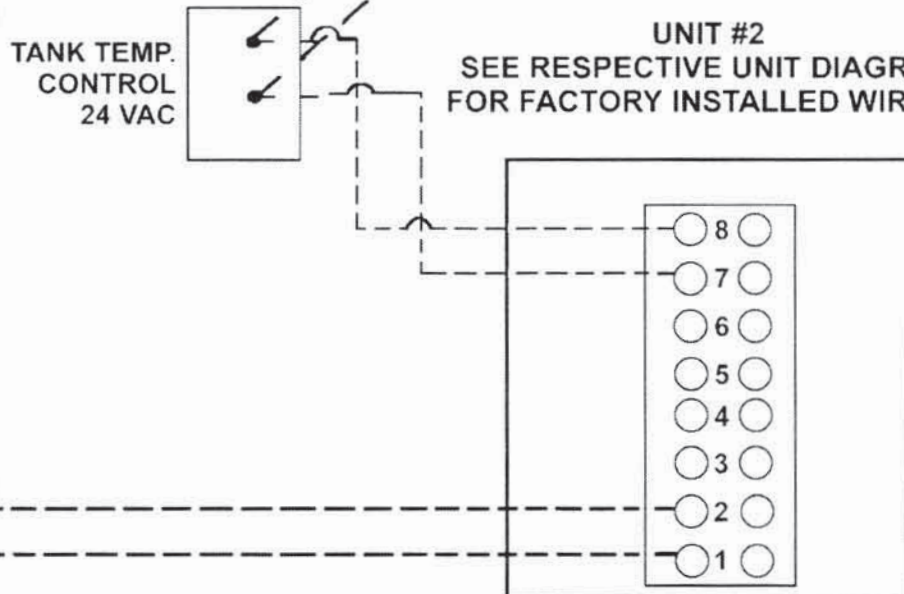

----- FIELD WIRING

IF ANY OF THE ORIGINAL WIRES AS SUPPLIED MUST BE REPLACED,
USE ONLY TYPE 105°C THERMOPLASTIC OR ITS EQUIVALENT.